
## **NOTICE OF PRODUCT CERTIFICATION**

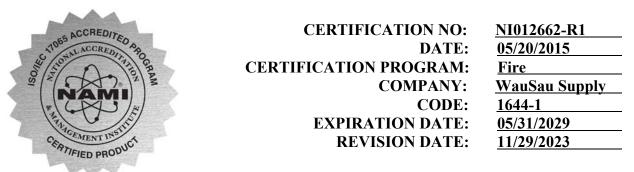

This certification represents product conformity to the applicable specification and that certification criteria has been satisfied. A NAMI approved certification label must be applied to the product to claim certification status. To affirm the certification status, please visit <u>www.namicertification.com</u>. NAMI is accredited to the ISO/IEC 17065 by the ANSI National Accreditation Board (ANAB) and the Standards Council of Canada (SCC).

COMPANY NAME AND ADDRESS	PRODUCT DESCRIPTION
Wausau Supply Company, Inc.	20 Minute Category C
8011 Technology Drive	<b>Proprietary Wood Door Frames</b>
Schofield, WI 54476	
	Manufacture Specific Fire Door Frames for Single and Double Swing Installation in 20 Minute Locations
	Single Door Maximum Size: 4'0" x 9'0" Double Door Maximum Size: 8'0" x 9'0"
	Minimum Thickness: 3-3/4"

UL 10C (1998)20 Minute-With & Without Hose StreamUBC Standard 7-2 (1997)Positive PressureUBC Standard 7-2 (1994)Category C- Proprietary Frame	SPECIFICATION	PRODUCT RATING
UBC Standard 7-2 (1994) Category C- Proprietary Frame	<b>UBC Standard 7-2 (1997)</b>	Positive Pressure
	<b>UBC Standard 7-2 (1994)</b>	<b>Category C- Proprietary Frame</b>

**TEST REPORT** 

Warnock Hersey Test Report No: WHI-495-0509 Intertek Test Report No(s): 3746699, 8772599, 3028781, 3035264, 3048460 Priest & Assoc. Engineering Evaluation No: 10260

Administrator's Signature:

NATIONAL ACCREDITATION AND MANAGEMENT INSTITUTE, INC.

4794 George Washington Memorial Highway

Hayes, VA 23072 Tel: (804) 684-5124 nami@namiinc.com

NOPC 03/30/2023