


# NOTICE OF PRODUCT CERTIFICATION

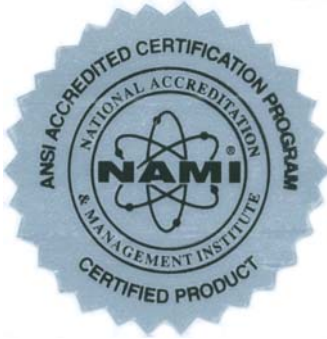

CERTIFICATION NO: NI013941-R1  
DATE: 01/23/2018  
CERTIFICATION PROGRAM: Fire  
COMPANY: Barnett Mill  
CODE: 529-1  
REVISION DATE: 01/04/2022  
EXPIRATION DATE: 01/31/2027

To verify that the "Notice of Product Certification" is valid, please visit [www.NAMICertification.com](http://www.NAMICertification.com) to assure that the product is active and currently listed. This certification represents product conformity to the applicable specification and that certification criteria has been satisfied. Please review and advise NAMI if any corrections are required to this document.

COMPANY NAME AND ADDRESS	PRODUCT DESCRIPTION
<b>Barnett Millworks, Inc.</b> <b>4915 Hamilton Blvd.</b> <b>Theodore, AL 36590</b>	<b>Plastpro's 90 Minute Positive Pressure</b> <b>Fire Door Assemblies w/Hose Stream</b>  Manufacturer Specific Fire Doors for Single Swing Installation in 90 Minute Locations  1/2" Minimum Latch Throw Single Swing Only  <b>Maximum Size: 4'0" x 8'0"</b>  <b>Minimum Thickness: 1-3/4"</b>

SPECIFICATION	PRODUCT RATING
<b>NFPA 252 (1999)/UL 10C (2001)/</b> <b>UL 10B (1997)</b> <b>UBC 7-2 (1994)</b> <b>CAN4 S104 (1985)</b>	<b>90 Minute-Positive Pressure</b> <b>With Hose Stream</b> <b>Category B - Additional Edge Sealing</b> <b>System Required</b>

TEST REPORT
<b>Intertek Test Report No: 3058118-02, 3058118-01</b>

Administrator's Signature: \_\_\_\_\_

## NATIONAL ACCREDITATION AND MANAGEMENT INSTITUTE, INC.

4794 George Washington Memorial Highway  
Hayes, VA 23072  
Tel: (804) 684-5124  
[nami@namiinc.com](mailto:nami@namiinc.com)