


NOTICE OF PRODUCT CERTIFICATION

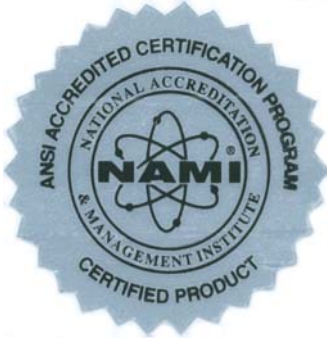

CERTIFICATION NO: NI014958-R1
DATE: 09/04/2020
CERTIFICATION PROGRAM: Fire
COMPANY: JELD-WEN
CODE: 1822-1
REVISION DATE: 05/10/2022
EXPIRATION DATE: 09/30/2024

This certification represents product conformity to the applicable specification and that certification criteria has been satisfied. A NAMI approved certification label must be applied to the product to claim certification status. To affirm the certification status, please visit www.namicertification.com. NAMI is accredited to the ISO/IEC 17065 by the ANSI National Accreditation Board (ANAB) and the Standards Council of Canada (SCC).

COMPANY NAME AND ADDRESS	PRODUCT DESCRIPTION
JELD-WEN 3737 Lakeport Boulevard Klamath Falls, OR 97601	Jeld Wen 45-60 Minute Flush Core Side-Hinged Door Manufacturer Specific Fire Doors for Single & Double Swing Installation in 45-60 Minute Locations 1/2" Minimum Latch Throw Single & Double Swing Only Single Maximum Size: 3'6" x 7'0" Single Maximum Size: 3'0" x 8'0" Double Maximum Size: 7'0" x 7'0" Double Maximum Size: 6'0" x 8'0" Minimum Thickness: 1-3/4"

SPECIFICATION	PRODUCT RATING
UL 10(c) (2009/2016) CAN4 S104 (1985) CAN/ULC-S104 (2015) NFPA 252 (2012)	45-60 Minute-Positive Pressure w/Hose Stream Category A Door-No Additional Edge Seal Required For Use in 16 & 18 Gauge Steel Frames <small>(or may also be installed in Category C or Category C-Proprietary in accordance with individual manufacturer's listing)</small>

TEST REPORT
Intertek Test Report No: G103003006MID-008, WHI-495-1607, J20017954-231, WHI-495-1456, G3043300, G3128474, G3186280, G3181954 NAMI Waiver of Retest: W-2028

Administrator's Signature: _____

A handwritten signature in black ink, appearing to be "Shi D".

**NATIONAL ACCREDITATION AND
MANAGEMENT INSTITUTE, INC.**

4794 George Washington Memorial Highway

Hayes, VA 23072

Tel: (804) 684-5124

nami@namiinc.com