


NOTICE OF PRODUCT CERTIFICATION

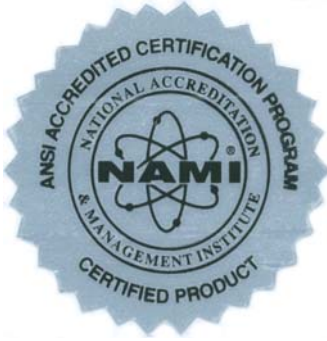

CERTIFICATION NO: NI014719
DATE: 03/02/2020
CERTIFICATION PROGRAM: Fire
COMPANY: Eagle River
CODE: 2625-1
EXPIRATION DATE: 03/31/2024

To verify that the "Notice of Product Certification" is valid, please visit www.NAMICertification.com to assure that the product is active and currently listed. This certification represents product conformity to the applicable specification and that certification criteria has been satisfied. A NAMI approved certification label must be applied to the product to claim certification status. Please review and advise NAMI if any corrections are required to this document.

COMPANY NAME AND ADDRESS	PRODUCT DESCRIPTION
Eagle River Door & Glass, LLC 335 South Eaglewood Lane, Suite 150 Eagle, ID 82616	Rogue Valley 20 Minute Positive Pressure Panel-Type MDF Side-Hinged Door Assembly Manufacturer Specific Fire Doors for Single & Double Swing Installation in 20 Minute Locations 1/2" Minimum Latch Throw Single & Double Swing Only Single Maximum Size: 3'6" x 8'0" Double Maximum Size: 7'0" x 8'0" Minimum Thickness: 1-3/4"

SPECIFICATION	PRODUCT RATING
UBC-7-2-94 UL 10B (1997)(2009) UL 10C(2009) NFPA 252 (2003)(2012) CAN4 S104 (1985)/CAN/ULC S104 (2010)	20 Minute-Positive Pressure w/Hose Stream Category A Door-No Additional Edge Seal Required For Use in Category C Frame <small>(or may also be installed in Category C-Proprietary in accordance with individual manufacturer's listing)</small>

TEST REPORT
Intertek Test Report No: 3049231/3049231a

A handwritten signature in black ink, appearing to be 'Shelley'.

Administrator's Signature: _____

**NATIONAL ACCREDITATION AND
MANAGEMENT INSTITUTE, INC.**

4794 George Washington Memorial Highway

Hayes, VA 23072

Tel: (804) 684-5124

Fax: (804) 684-5122